



PREPARED BY:	SANDIA NATIONAL LABORATORIES FACILITIES ENGINEERING	DETAIL NO.:
CHECKED BY:		MP5024
DATE:	REV:	SCALE:
04/20/06	B	NONE
PUMP GAUGE		MECHANICAL STANDARD

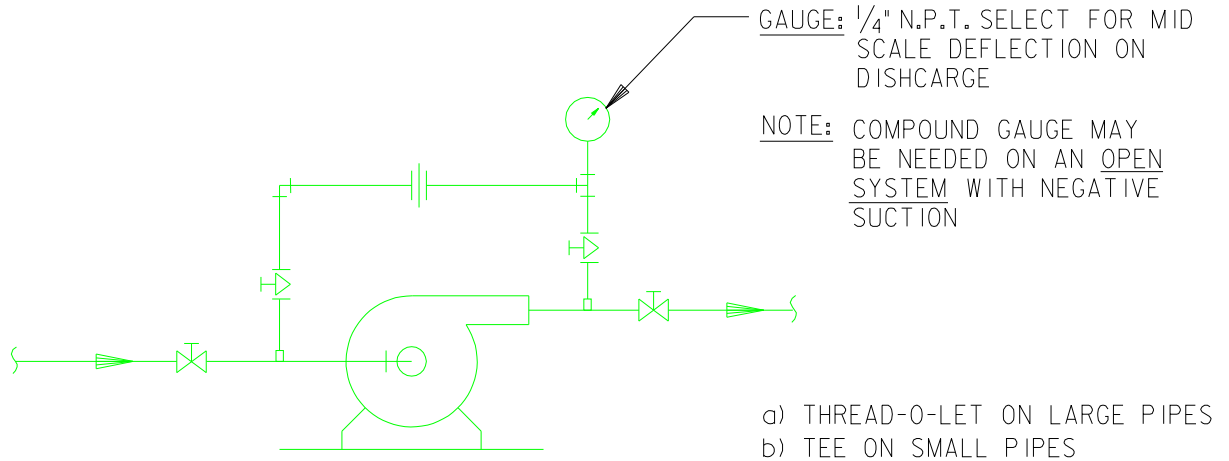

PREFERRED METHOD

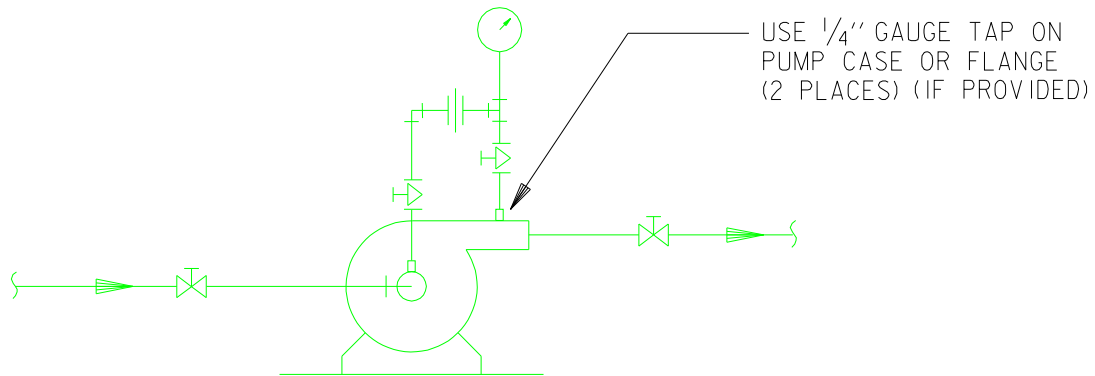

ALTERNATE METHOD